




Water Department Report

As of October 31, 2019

City of Garden Ridge Well Usage

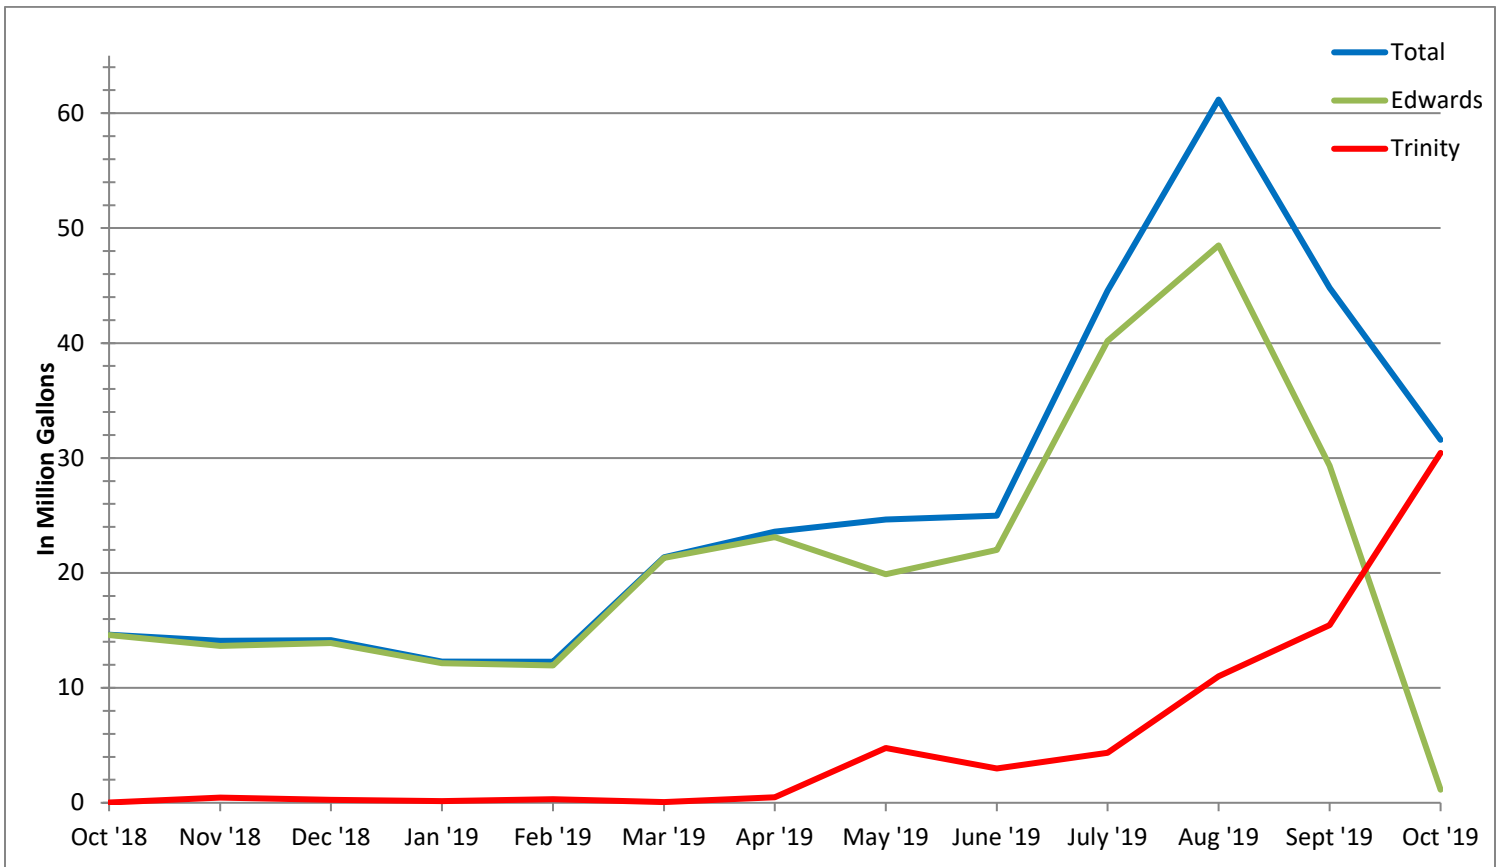


	Month:	Year:	Available:	Stage:
Edwards Well Usage AC/FT:	3.49	702.04	6.66	0
Trinity Well Usage AC/FT:	93.42	213.34	N/A	0%

Water Quality

Bacteriological:	6	0	6	0
Raw:	4	0	4	0
Chlorine Residual Test:	31	0	31	0

2018 – 2019 Pumping Report

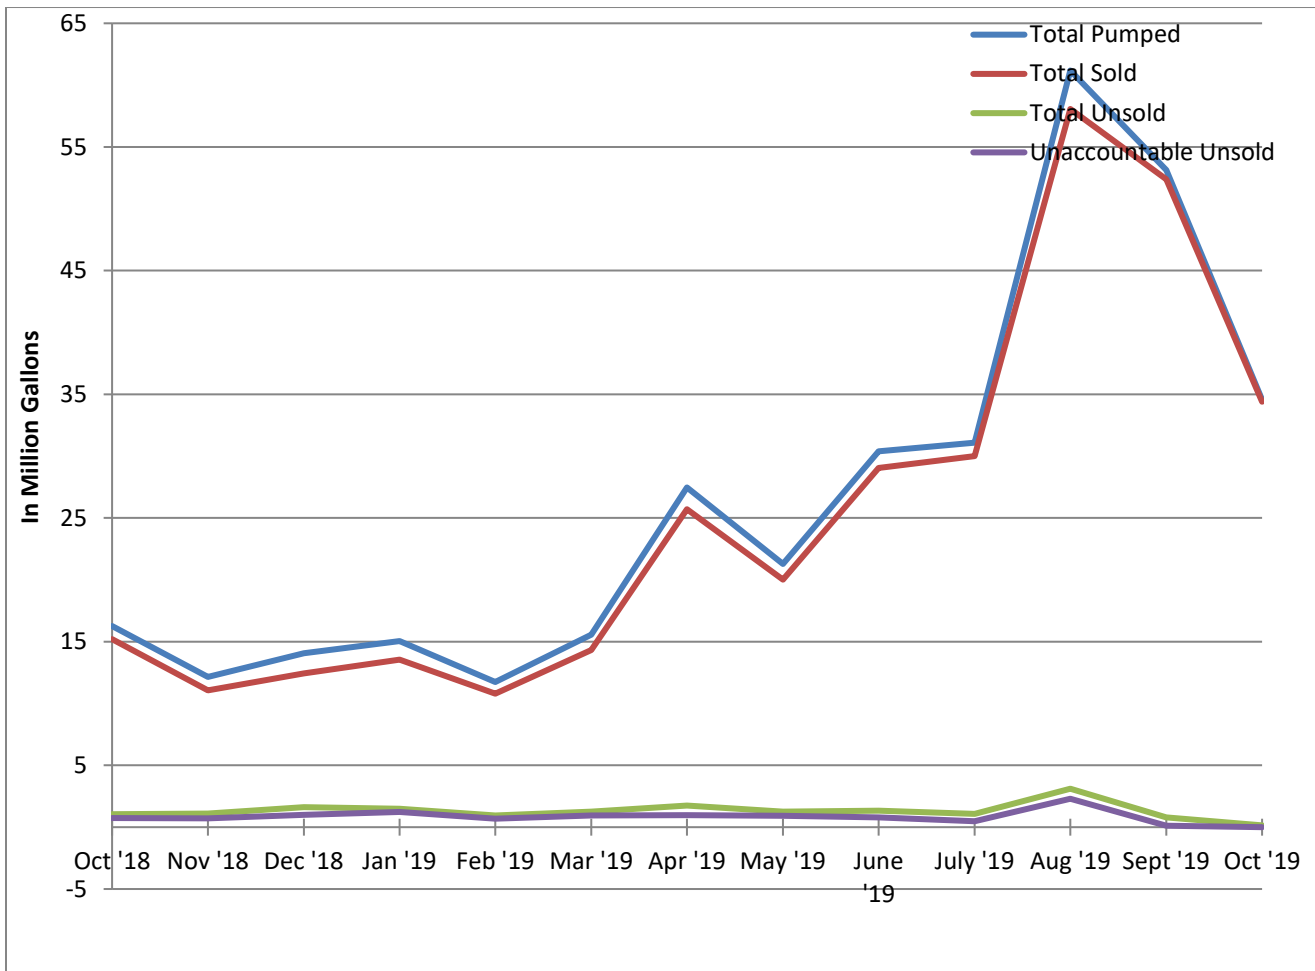

	Total Pumped (Thousands)	Total Sold (Thousands)	Total Unsold (Thousands)	Unaccountable Unsold (Thousands)	Unaccountable Unsold %
Oct '18	16,256	15,198	1,058	749	4.6%
Nov '18	12,153	11,057	1,096	703	5.8%
Dec '18	14,073	12,447	1,626	998	7.1%
Jan '19	15,035	13,556	1,479	1,228	8.2%
Feb '19	11,738	10,795	943	691	5.9%
Mar '19	15,572	14,324	1,248	937	6.0%
Apr '19	27,464	25,712	1,752	985	3.6%
May '19	21,278	20,016	1,262	899	4.2%
June '19	30,391	29,047	1,343	802	2.6%
July '19	31,078	29,996	1,082	475	1.5%
Aug '19	61,184	58,074	3,110	2,298	3.8%
Sept '19 *	53,145	52,395	786	125	0.2%
Oct '19 *	34,551,793	34,405,000	146,793	0	0.0%

* September water loss is off due to inaccuracy of the Schoenthal well master meter.

Water Department Monthly Activities:

New Meter Installs	9	Work Orders	299
Meter Replacements	0	Locates	19
City Owned Leaks	3	Irrigations Permits Issued	0
Meters Read	1,684	Total Rebates	4

Leak Adjustments

Requests	38	Waiting for Information	24	Approved	6	Denied	2	Sent to Water Commission	6
----------	----	-------------------------	----	----------	---	--------	---	--------------------------	---

Field Meter Flow Test

Meters Flow Tested	Passed	Failed
23	23	0

Laptop readings	Analyzed
89	65

Projects:

- Whispering Oaks Project is Ongoing
- Meter Testing and Laptop Readings
- Brad Olivarri Obtained his Backflow & Assembly License from TCEQ
- The Smaller tank at 2252 is now back online.
- We Winterized our Well Sites