




Water Department Report

As of March 31, 2020

City of Garden Ridge Aquifer Usage

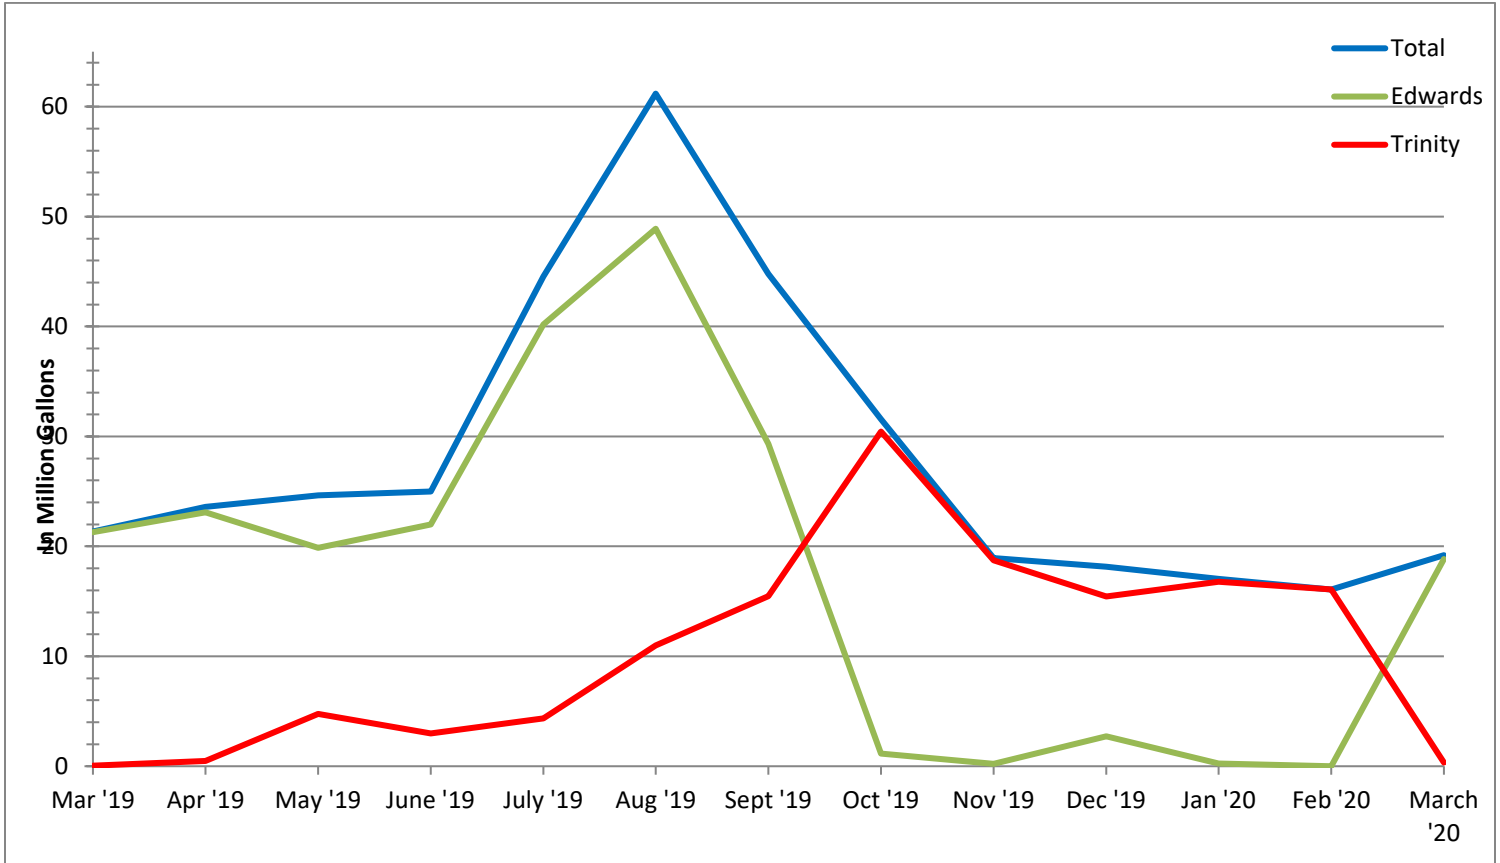


	Month:	Year:	Available:	Stage:
Edwards Well Usage AC/FT:	57.83	58.63	657.03	0
Trinity Well Usage AC/FT:	1.063	101.89	N/A	0%

Water Quality

	Due:	Missed:	Passed:	Failed:
Bacteriological:	6	0	6	0
Raw:	4	0	4	0
Chlorine Residual Test:	31	0	31	0

2018 – 2019 Pumping Report

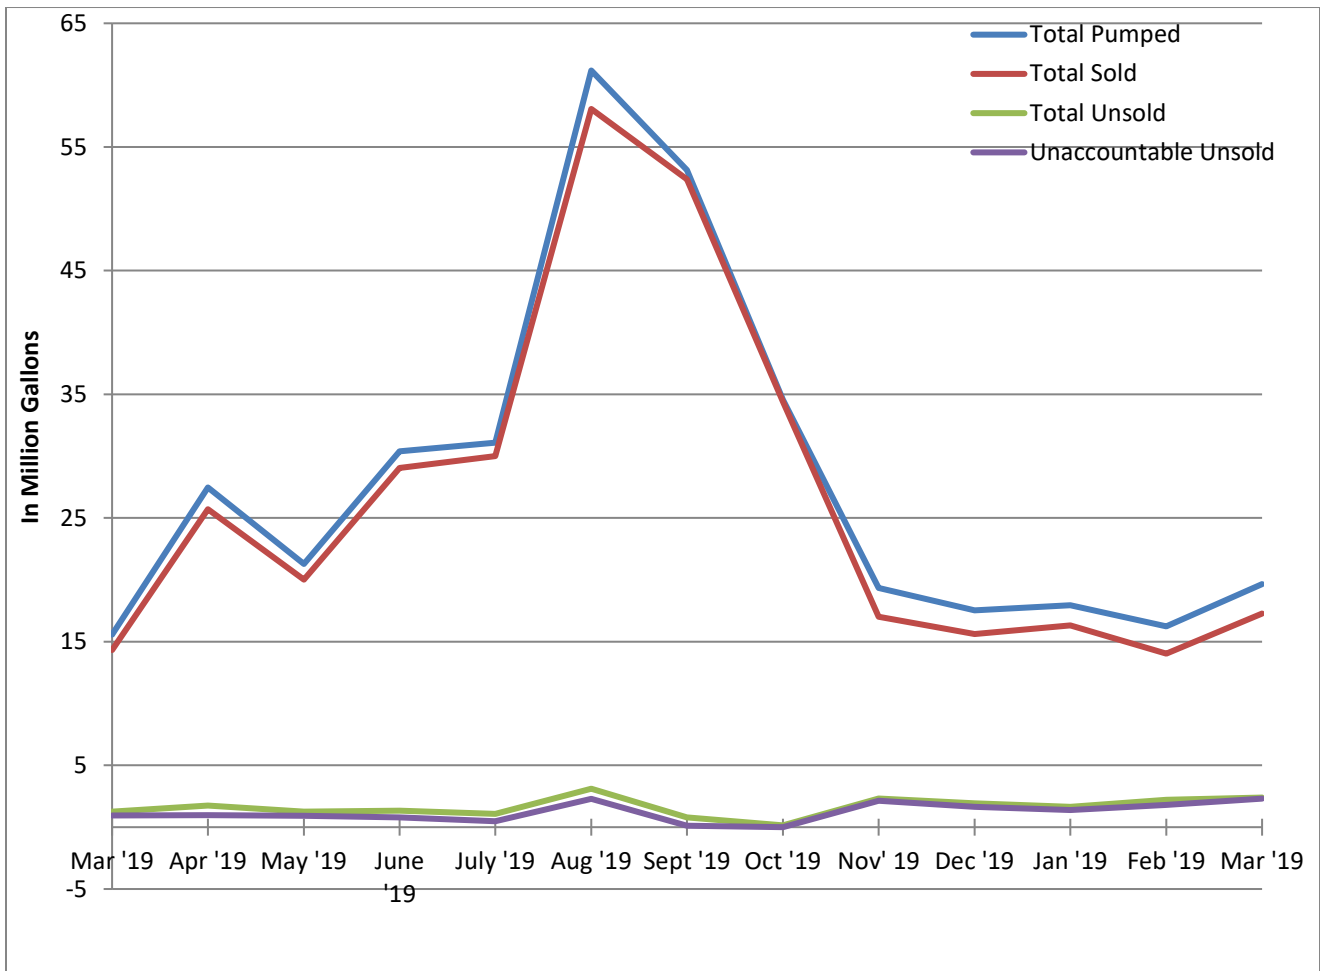

	Total Pumped (Thousands)	Total Sold (Thousands)	Total Unsold (Thousands)	Unaccountable Unsold (Thousands)	Unaccountable Unsold %
Mar '19	15,572	14,324	1,248	937	6.0%
Apr '19	27,464	25,712	1,752	985	3.6%
May '19	21,278	20,016	1,262	899	4.2%
June '19	30,391	29,047	1,343	802	2.6%
July '19	31,078	29,996	1,082	475	1.5%
Aug '19	61,184	58,074	3,110	2,298	3.8%
Sept '19 *	53,145	52,395	786	125	0.2%
Oct '19 *	34,551	34,405	146	0	0.0%
Nov '19	19,344	17,022	2,322	2,149	11.1%
Dec '19	17,527	15,610	1,917	1,657	9.5%
Jan '20	17,956	16,308	1,648	1,388	7.7%
Feb '20	16,250	14,032	2,218	1,806	11.1%
March '20	19,658	17,270	2,388	2,308	11.7%

* September water loss is off due to inaccuracy of the Schoenthal well master meter.

Water Department Monthly Activities:

New Meter Installs	0	Work Orders	75
Meter Replacements	1	Locates	11
City Owned Leaks	0	Irrigations Permits Issued	0
Meters Read	1,664	Total Rebates	0
Meter Tests	0	Laptop Readings	8

Leak Adjustments

New Requests	4	Waiting for Customer	0	Approved	1	Amount Approved	\$9.11	Denied	0	Sent to Water Commission	6
--------------	---	----------------------	---	----------	---	-----------------	--------	--------	---	--------------------------	---

Projects:

- Whispering Oaks Project is Ongoing
- Work Order Data Retention Ongoing
- Cleaning the Well Sites Ongoing
- Cl-10 Installation Complete
- Water Master Plan Phase 1 &2

COVID-19

The Water Department is taking steps in order to keep our staff and infrastructure safe from the spread of the Coronavirus. Combining efforts with the Public Works Department to keep each other safe, we are cleaning facilities, vehicles, and equipment daily. To ensure our staff and water system stay safe, our team members have staggering work shifts to provide the same level of service with very little team member interaction. This threat has not stopped the functionality or the safety of our city's water infrastructure. We are also limiting our interaction with the public when possible and keeping a safe distance when it is not. These necessary steps are being taken to help stop the spread and bring this unfortunate turn of events to an end.